




Catalog Number: TS10-0016
Item Description: 10POLE TEST SWITCH
UPC Code: 784572132320

Brand Name: Milbank
Type: Instrument Rated Metering Test Switch
Application: Test Point
Standard: UL Listed
Voltage Rating: 600 Volts Alternating Current
Amperage Rating: 20 Ampere
Frequency Rating: 60 Hertz
Connection: Stud

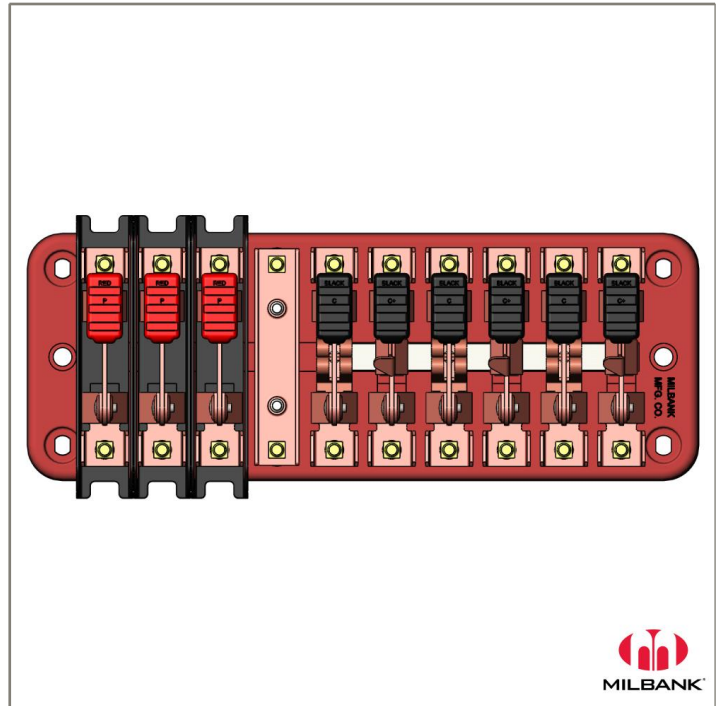


Utility requirements may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must always be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.



Catalog Number: TS10-0016
Item Description: 10POLE TEST SWITCH
UPC Code: 784572132320

Brand Name: Milbank
Type: Instrument Rated Metering Test Switch
Application: Test Point
Standard: UL Listed
Voltage Rating: 600 Volts Alternating Current
Amperage Rating: 20 Ampere
Frequency Rating: 60 Hertz
Connection: Stud

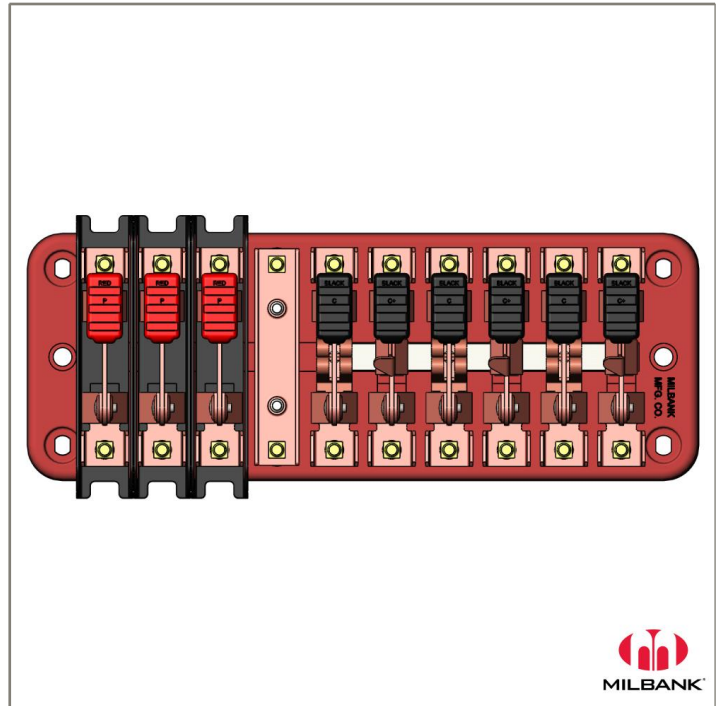

Utility requirements may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must always be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.